



Coastside Fire Protection District
Fire Prevention Bureau
Standard Detail & Specification Manual

Section: Developer Information

Effective: Dec. 13, 2011

Title: Bollard / Guard Post


Revised: Dec. 23, 2019

Number: Requirements DI-015

Approved: *Gary Silva*

Bollard/Guard Post

Construction Guidelines:

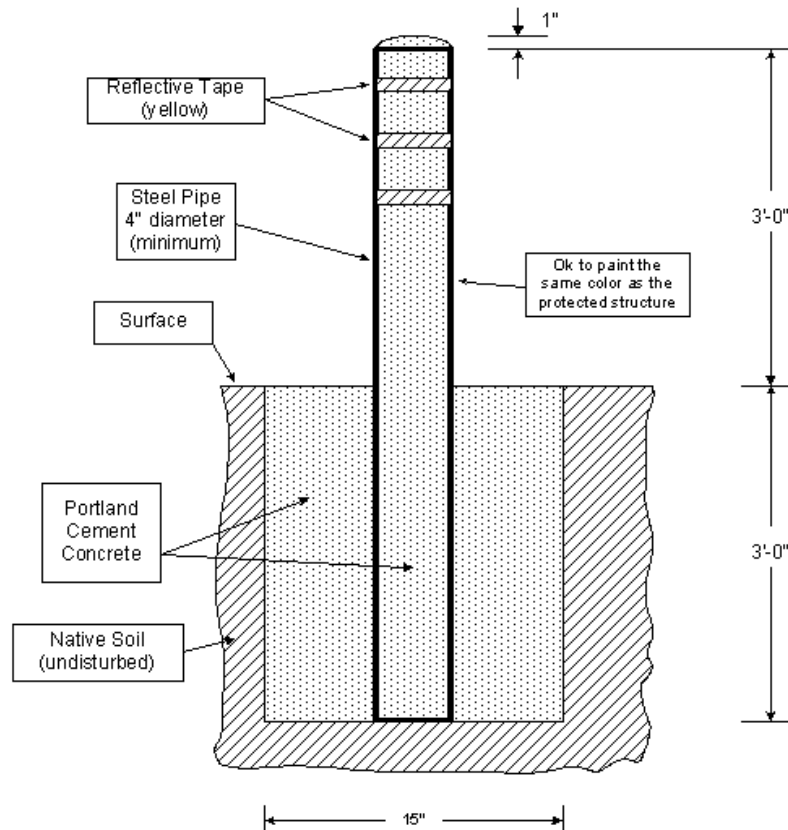

NOTE: Ballards will not be spaced more than 4' on center.

Guard post to be completely filled with concrete. 2019 CFC 312

Note: When protection aboveground fuel tank, guard posts shall be a minimum of 3 feet from tank and painted yellow.